
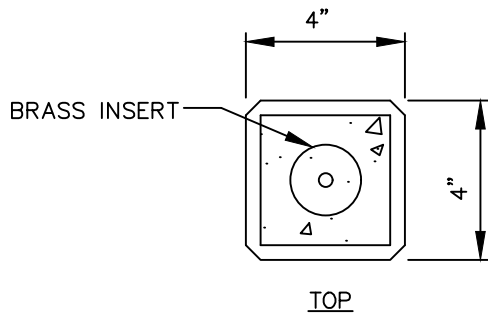


NOTES:


1. CHAMFER ON FRONT TWO SIDES.
2. BRASS PLATE ON TOP WITH DISTANCE AND DIRECTION OF VALVE. FOR BVs # OF TURNS REQUIRED TO FULLY OPEN/CLOSE
3. TWO #3 REBAR REINFORCING.
4. CONCRETE 3000 PSI
5. CAST LETTERING ON FRONT SIDE
6. PLACE AT ALL VALVE LOCATIONS OR AS DIRECTED BY ENGINEER
7. PIPELINE MARKERS TO BE LOCATED EVERY 1000' ALONG THE WATER LINE & ABOVE FITTINGS WHERE THE ALIGNMENT CHANGES, OR AS DIRECTED BY THE ENGINEER.

CAST LETTERING

- AV - AIR RELEASE VALVE
- MV - MAINLINE GATE VALVE (<12")
- WV - GATE VALVE AT FIRE HYDRANT LOCATIONS
- BV - MAINLINE BUTTERFLY VALVE
- PV - SEWER PLUG VALVE

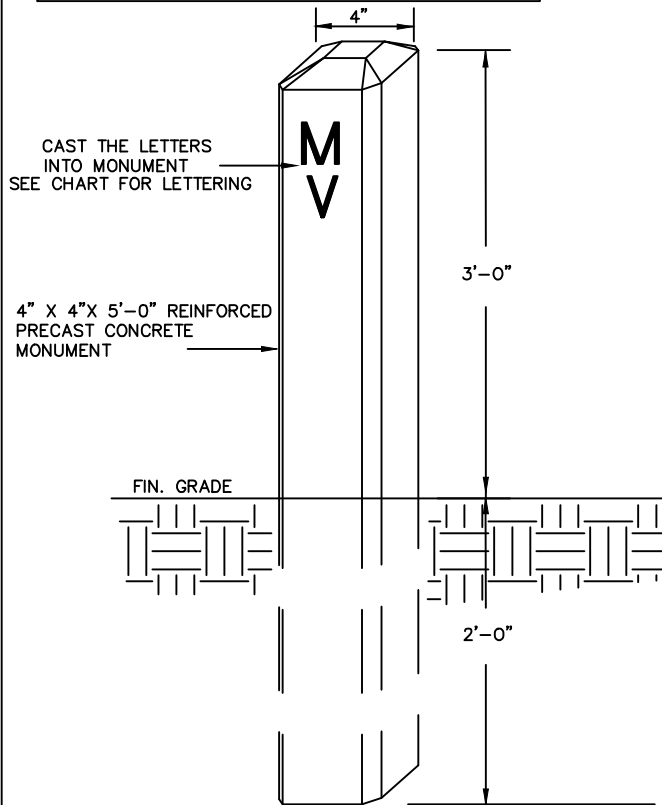

VALVE MARKER
NOT TO SCALE

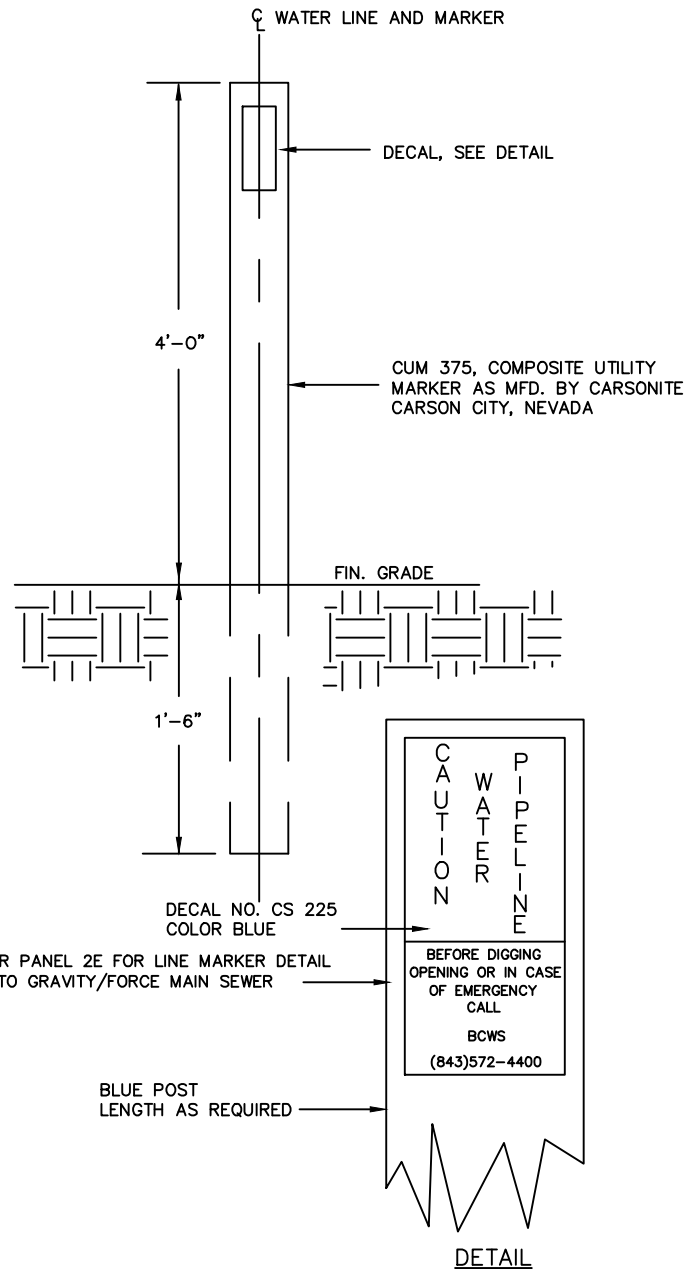

LINE MARKER
NOT TO SCALE

WATER/SEWER PANEL 9