


**OPENING DETAIL — PLAN VIEW**  
N.T.S.

MONOLITHIC POUR SLAB TOP

CONCRETE PERSONNEL PAD SHALL HAVE ADEQUATE SLOPE TO PROVIDE POSITIVE DRAINAGE AWAY FROM THE WET WELL.

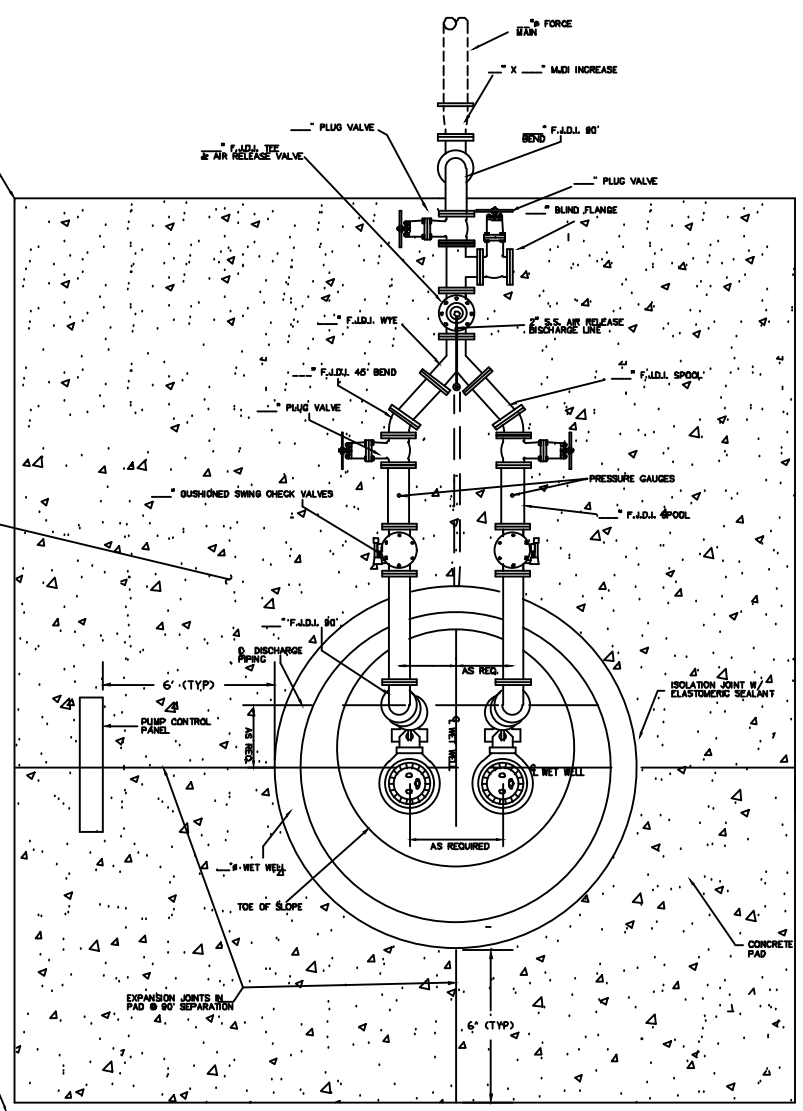

PLAN

***TYPICAL SMALL PUMP STATION  
PLAN VIEW***

NOT TO SCALE

**SEWER PANEL 3A**

BERKELEY COUNTY WATER AND SANITATION  
POTABLE WATER & SANITARY SEWER STANDARDS  
REVISED 04/25/2023