


GENERAL NOTES:

1. THIS PUMP STATION SITE PLAN IS TYPICAL. CONDITIONS MAY CHANGE FROM ONE PUMP STATION THE NEXT. PLEASE MODIFY THIS LAYOUT TO REFLECT THE PROPOSED PUMP STATION SITE.
2. PLEASE SHOW GRADES ON THIS DETAIL WHEN SUBMITTING FOR REVIEW AND APPROVAL.
3. WHEN DESIGNING THE PUMP STATION LAYOUT, ENSURE ALL EQUIPMENT IS ARRANGED SO THAT A CLEAR AREA IS RESERVED TO ALLOW A LARGE VEHICLE (I.E. VACTOR TRUCK) THE ABILITY TO TURN AROUND INSIDE THE FENCED AREA.
4. ASPHALT (SCDOT TYPE-C) TO BE PLACED IN ALL AREAS WITHIN THE FENCE THAT IS NOT COVERED BY CONCRETE. THIS INCLUDES THE ACCESS DRIVE, TURN-OUT, AND A MINIMUM OF 6" OUTSIDE OF THE FENCE.

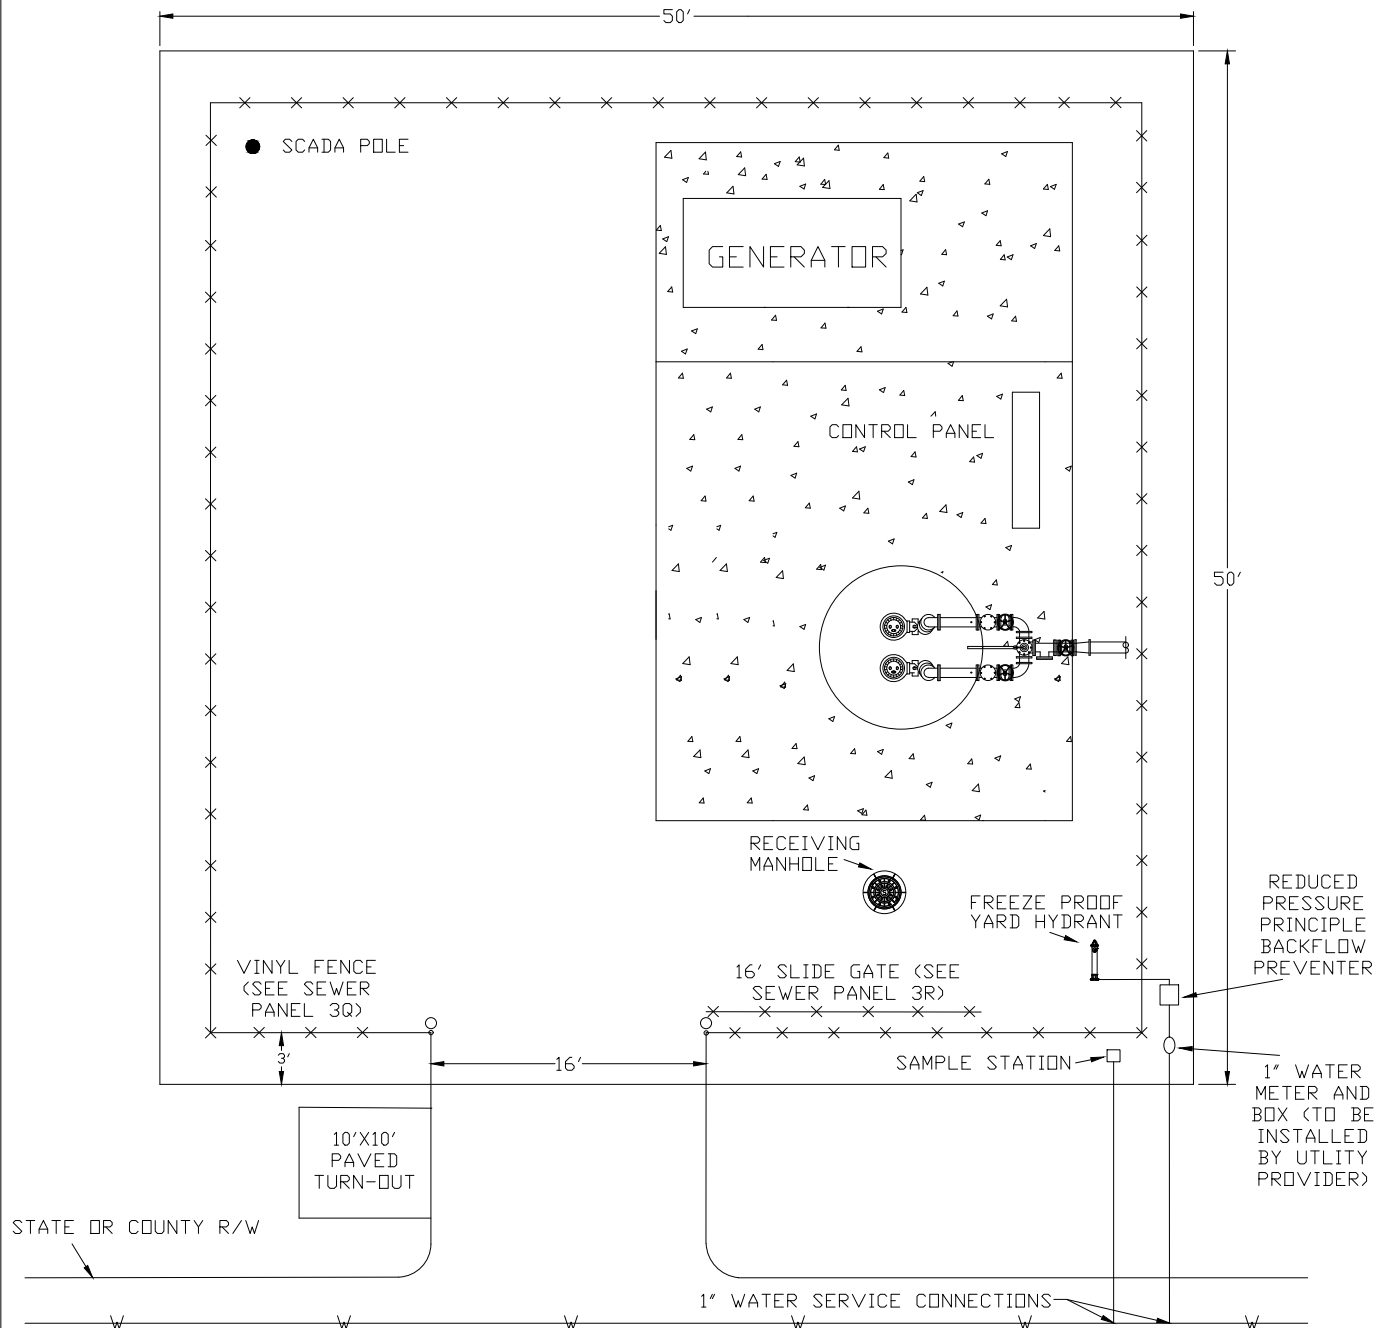

*TYPICAL PUMP STATION SITE PLAN*

NOT TO SCALE

**SEWER PANEL 3E**

**BERKELEY COUNTY WATER AND SANITATION  
POTABLE WATER & SANITARY SEWER STANDARDS**

REVISED 07/24/2025