


NOTES:

1. SWING GATES ARE TO BE USED ONLY WHEN STATION SPACE DOES NOT PERMIT A SLIDE GATE.
2. FOOTING WIDTH TO BE TWICE POST WIDTH OR A MINIMUM OF 18" DIAMETER. MINIMUM DEPTH 36".
3. ALL POSTS SHALL INCORPORATE ALUMINUM STIFFENER INSERTS AND SHALL BE INSTALLED PER MANUFACTURER'S INSTRUCTIONS.
4. SUBMIT SHOP DRAWINGS, GATE DESIGN, COLOR SAMPLES AND LAYOUT TO BCWS AND ENGINEER.
5. FENCE COMPONENTS (POSTS, RAILS, PICKETS, GATE, UPRIGHTS, POST CAPS AND ACCESSORIES) SHALL BE OF HIGH IMPACT ULTRA VIOLET (U.V.) RESISTANT, RIGID PVC. INSTALL ACCORDING TO MANUFACTURER'S RECOMMENDATIONS (www.fencecenter.com)
6. ALL GATES MUST BE ABLE TO BE LOCKED WITH PADLOCK.
7. DROP RODS AND REQUIRED DROP ROD STOP PIPES ARE TO BE INSTALLED FOR ALL GATES.

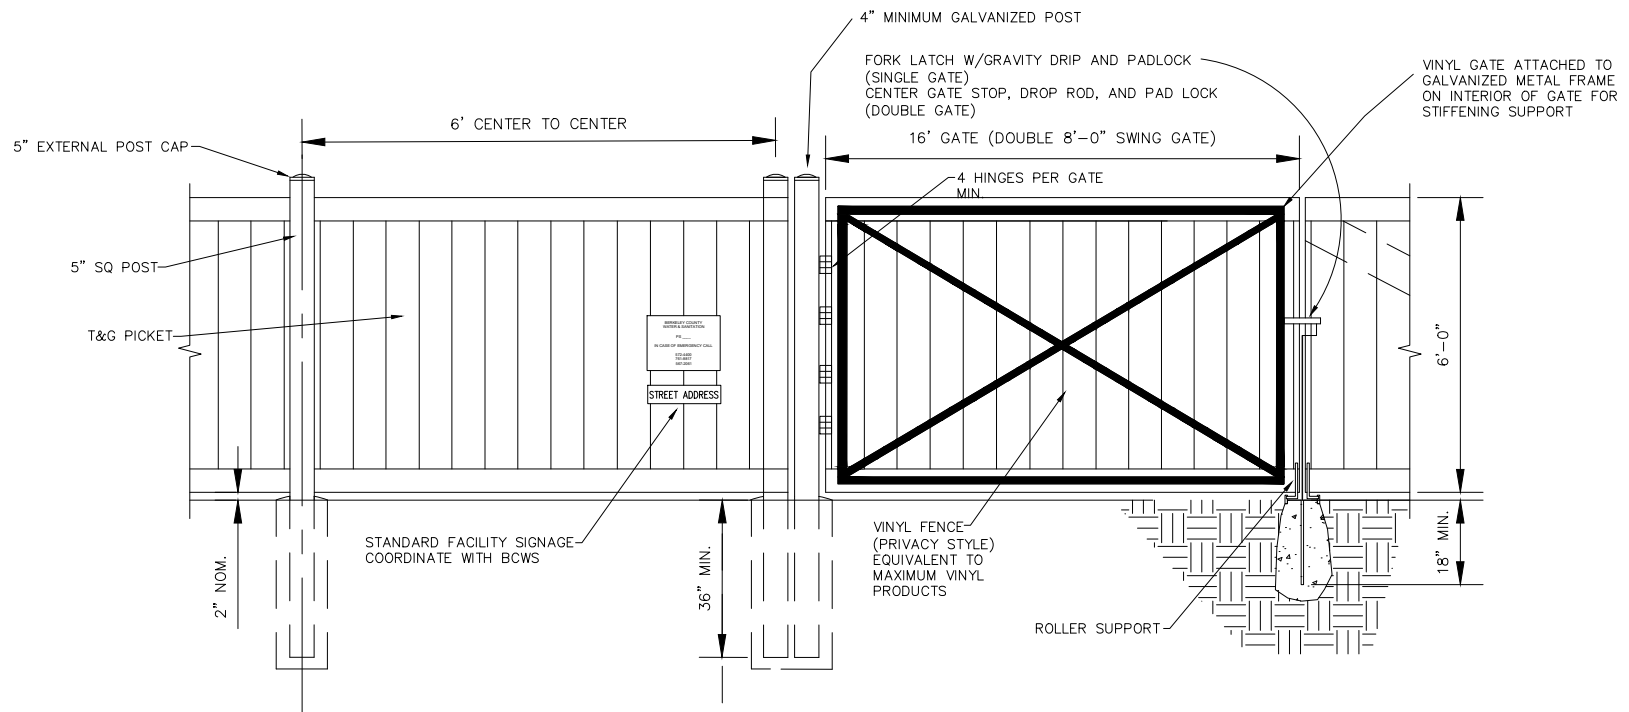

*PUMP STATION PRIVACY FENCE
AND SWING GATE DETAIL (PVC)*

NOT TO SCALE

SEWER PANEL 30

BERKELEY COUNTY WATER AND SANITATION
POTABLE WATER & SANITARY SEWER STANDARDS

REVISED 07/28/2025