


NOTES:

1. FOOTING WIDTH TO BE TWICE POST WIDTH OR A MINIMUM OF 18" DIAMETER. MINIMUM DEPTH 36".
2. ALL POSTS SHALL INCORPORATE ALUMINUM STIFFENER INSERTS AND SHALL BE INSTALLED PER MANUFACTURER'S INSTRUCTIONS.
3. SUBMIT SHOP DRAWINGS, GATE DESIGN, COLOR SAMPLES AND LAYOUT TO BCWS AND ENGINEER. APPROVALS NEEDED PRIOR TO INSTALLATION.
4. FENCE COMPONENTS (POSTS, RAILS, PICKETS, GATE, UPRIGHTS, POST CAPS AND ACCESSORIES) SHALL BE OF HIGH IMPACT ULTRA VIOLET (U.V.) RESISTANT, RIGID PVC. INSTALL ACCORDING TO MANUFACTURES RECOMMENDATIONS (WWW.FENCECENTER.COM).
5. ALL GATES MUST BE ABLE TO BE LOCKED WITH PADLOCK.
6. FENCE TO BE WITHIN 6" OF ASPHALT.
7. SLIDING GATE FRAME TO BE CONSTRUCTED OF WELDED ALUMINUM SQUARE TUBING.
8. SEE DETAIL A FOR FENCE NESTING LATCH POST LOCATION.

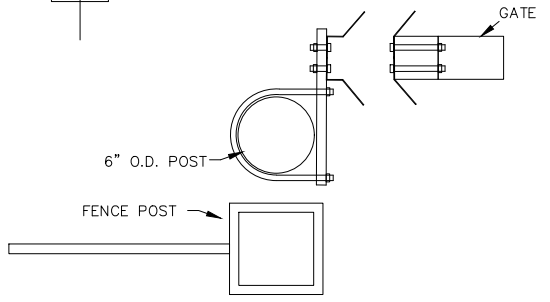

DETAIL A

***PUMP STATION PRIVACY FENCE  
AND SLIDE GATE DETAIL (PVC)***  
NOT TO SCALE

**SEWER PANEL 3R**

BERKELEY COUNTY WATER AND SANITATION  
POTABLE WATER & SANITARY SEWER STANDARDS  
REVISED 07/29/2025