


- NOTES:**
1. ALL HARDWARE SHALL BE 304 OR 316 STAINLESS STEEL UNLESS OTHERWISE NOTED.
 2. MANHOLE INTERIOR AND PIPES SHALL BE LINED WITH APPROVED EPOXY LINER. SEE APPROVED PART LIST.
 3. TRACER WIRE BOX TO BE INSTALLED WITHIN 3' OF AIR RELEASE VALVE.

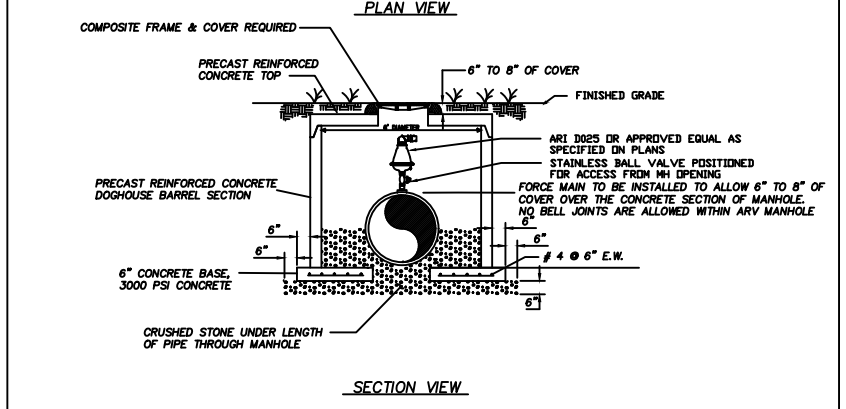

SEWER AIR RELEASE VALVE AND MANHOLE
NTS

SEWER PANEL 5A

BERKELEY COUNTY WATER AND SANITATION
POTABLE WATER & SANITARY SEWER STANDARDS
REVISED 04/25/2023