


Notes:

1. BACKFILL WITH SUITABLE MATERIAL COMPACTED TO 95% MODIFIED PROCTOR (ASTM D-1557) FOR COARSE GRAINED SOILS (SANDS) AND 98% COMPACTION OF THE STANDARD PROCTOR (ASTM D-698) SHALL BE USED FOR FINE GRAINED SOILS (CLAYS/SILTS). SEE BCWS SPECS OR NOTES ON APPROVED PLANS FOR ANY ADDITIONAL REQUIREMENTS.
2. IF BEDDING IS WASHED STONE, ONLY VIBRATORY PLATE TAMPING IS NECESSARY AND NO OFFICIAL DENSITY TESTING REQUIRED UNLESS OTHERWISE STATED OR APPROVED BY BCWS, BCRB OR SCDOT.

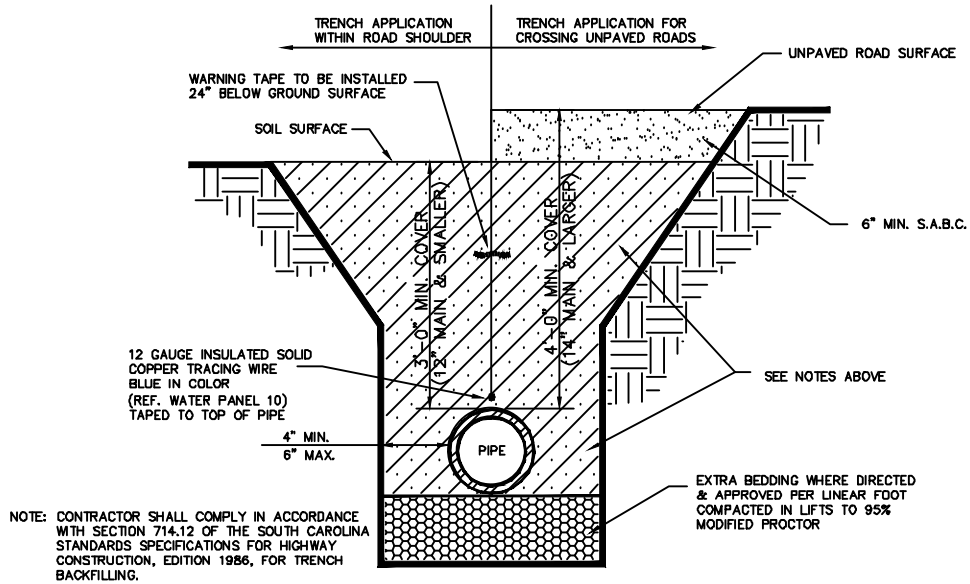

WATER MAIN TRENCH DETAIL

NOT TO SCALE

WATER PANEL 8

**BERKELEY COUNTY WATER AND SANITATION
POTABLE WATER & SANITARY SEWER STANDARDS**

REVISED JULY/2025