
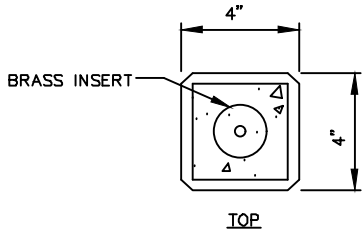


**NOTES:**

1. CHAMFER ON FRONT TWO SIDES.
2. BRASS PLATE ON TOP WITH DISTANCE AND DIRECTION OF VALVE. FOR BVs # OF TURNS REQUIRED TO FULLY OPEN/CLOSE
3. TWO #3 REBAR REINFORCING.
4. CONCRETE 3000 PSI
5. CAST LETTERING ON FRONT SIDE
6. PLACE AT ALL VALVE LOCATIONS OR AS DIRECTED BY BCWS/ENGINEER
7. PIPELINE MARKERS TO BE LOCATED EVERY 1000' ALONG THE WATER LINE & ABOVE FITTINGS WHERE THE ALIGNMENT CHANGES, OR AS DIRECTED BY THE ENGINEER.


**CAST LETTERING**

- AV - AIR RELEASE VALVE
- MV - MAINLINE GATE VALVE (<12")
- WV - GATE VALVE AT FIRE HYDRANT LOCATIONS
- BV - MAINLINE BUTTERFLY VALVE
- PV - SEWER PLUG VALVE
- TW - TRACER WIRE

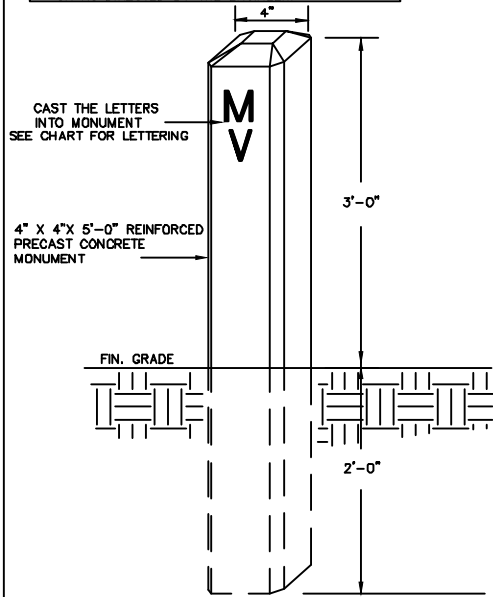

***VALVE MARKER***


NOT TO SCALE

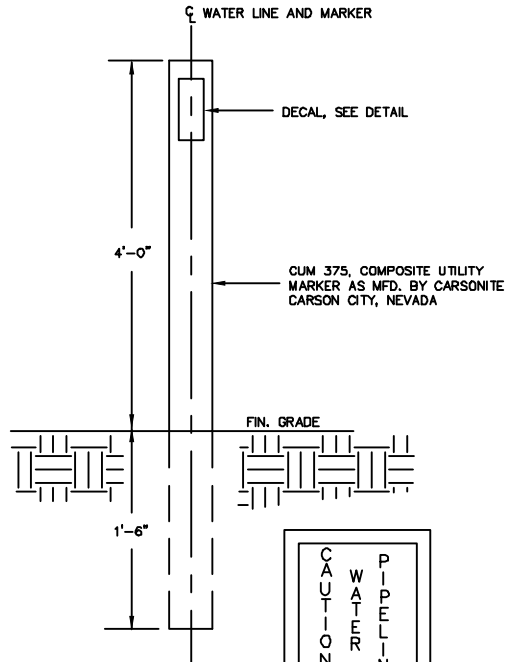

DECAL NO. CS 225  
COLOR BLUE

SEE SEWER PANEL 2E FOR LINE MARKER DETAIL SPECIFIC TO GRAVITY/FORCE MAIN SEWER

BLUE POST LENGTH AS REQUIRED

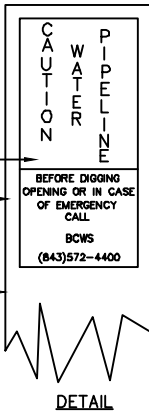

***LINE MARKER***

NOT TO SCALE

**WATER/SEWER PANEL 9**

**BERKELEY COUNTY WATER AND SANITATION  
POTABLE WATER & SANITARY SEWER STANDARDS**

REVISED JULY/2025