


- NOTE: PIPELINE MARKERS TO BE LOCATED:
1. EVERY 1000' MINIMUM ALONG THE SEWER FORCE MAIN.
 2. AT FORCE MAIN FITTINGS WHERE THE ALIGNMENT CHANGES
 3. AT TRACER WIRE/DUMMY VALVE BOX LOCATIONS
 4. BESIDE MANHOLES WHERE VEGETATIVE GROWTH IS HIGH FOR LOCATING PURPOSES
 5. OR AS DIRECTED BY THE ENGINEER

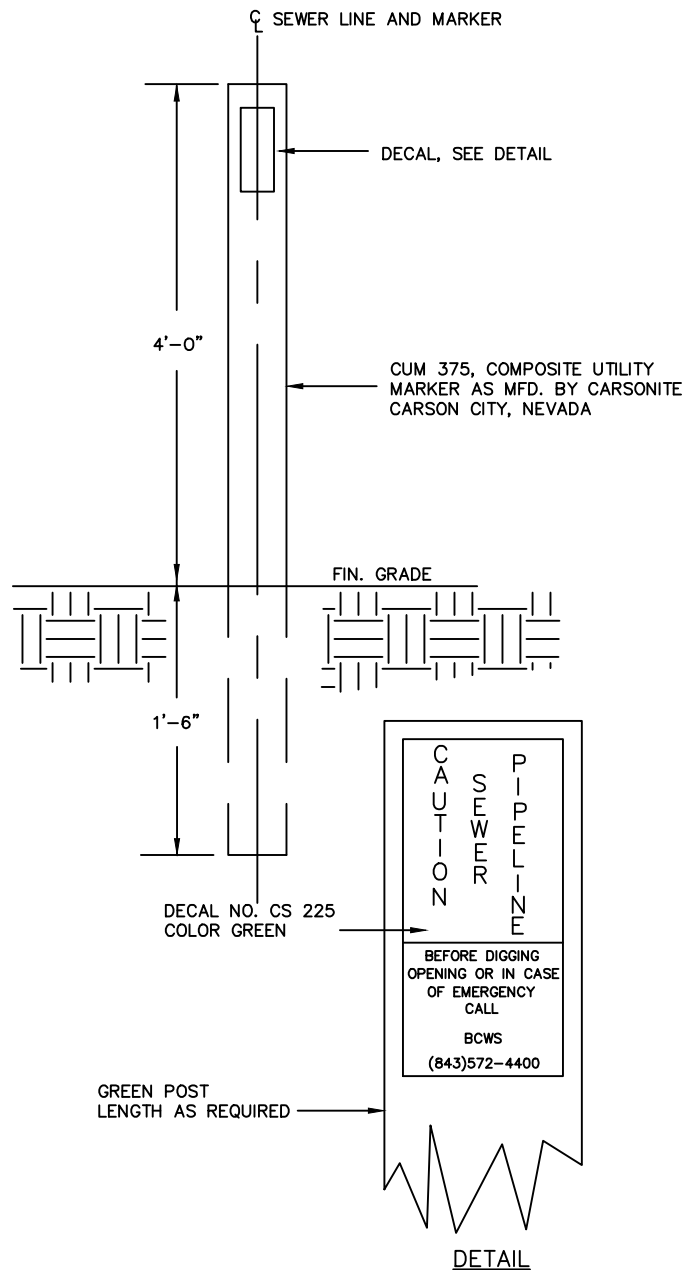

SEWER LINE MARKER

NOT TO SCALE

SEWER PANEL 2E

**BERKELEY COUNTY WATER AND SANITATION
POTABLE WATER & SANITARY SEWER STANDARDS**

REVISED 04/25/23