


NOTES:

1. 36" MINIMUM COVER ON P.E. TUBING TO BE WITHIN 12" OF PEDESTAL.
2. VALVE SHALL BE INSTALLED WITH A VALVE BOX, COVER, AND CONCRETE VALVE MARKER STAMPED "ARV".
3. THE WIRE AND TAPE SHALL MEET BCWS STANDARDS.
4. TRACER WIRE SHALL BE BLUE IN COLOR FOR WATER MAIN.
5. FOR LARGER THAN 2" ARVS, SEE ARV MANHOLE INSTALLATION SEWER PANEL 5A.

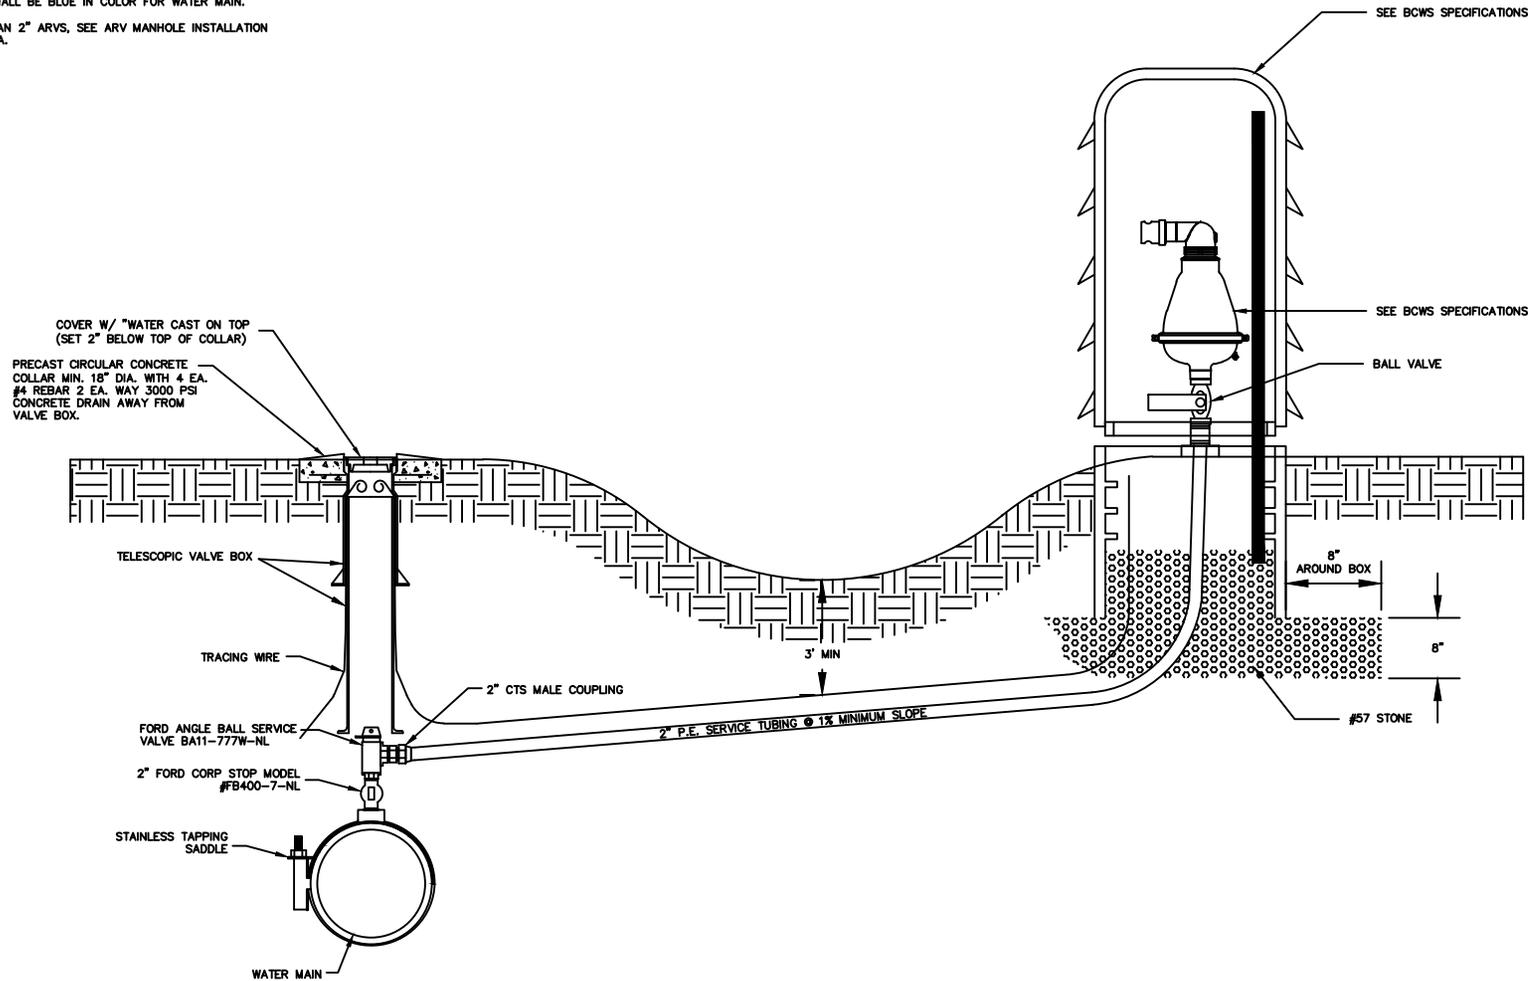

*WATER ABOVE GROUND AIR RELEASE VALVE*  
NOT TO SCALE

**WATER PANEL 11A**

BERKELEY COUNTY WATER AND SANITATION  
POTABLE WATER & SANITARY SEWER STANDARDS

REVISED 04/25/2023