NOTES:

1. BOX AND TOP SHALL SUPPORT H-20 TRAFFIC LOADING
2. MANHOLE FRAME AND COVER TO BE TRAFFIC (H-20), TYPE, 24" CLEAR OPENING.
3. MANHOLE COVER TO BE WITHOUT LETTERING.
4. USE BOXLOK OR VALVE BOX ADAPTOR II FOR CENTERING BOXES OVER VALVES.

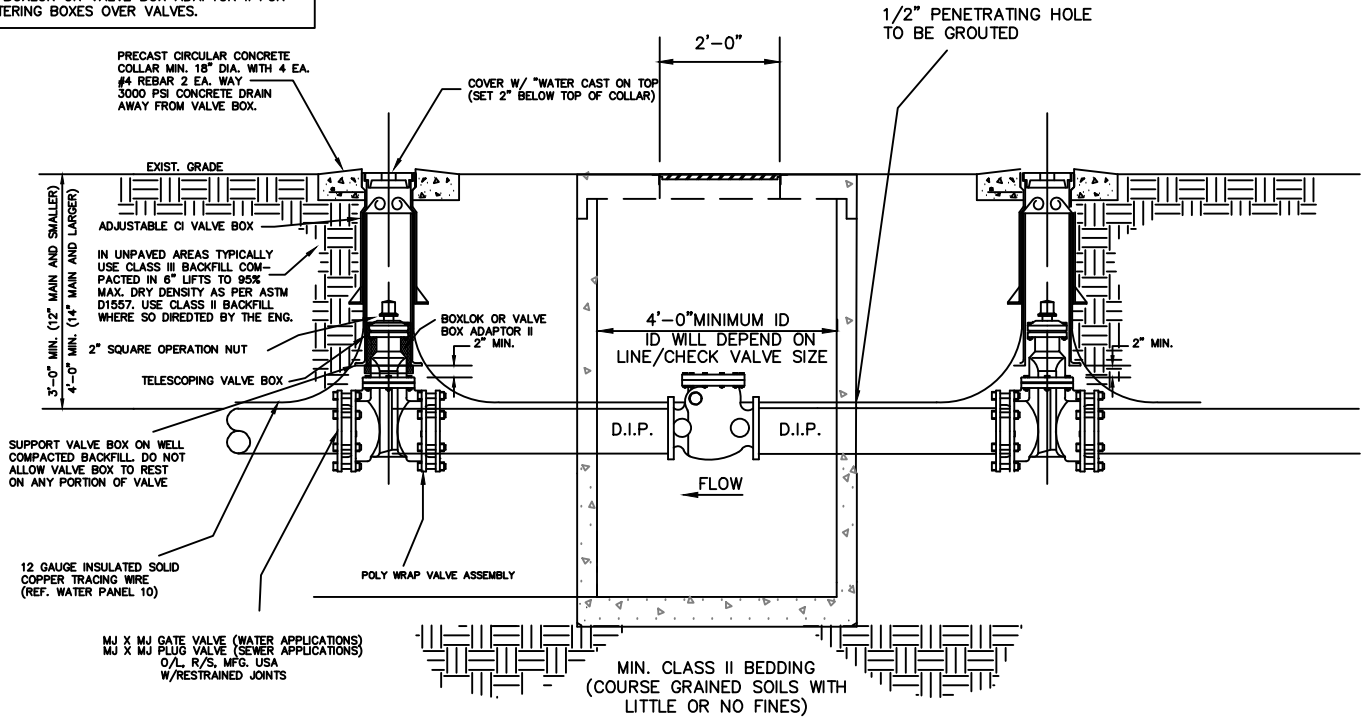

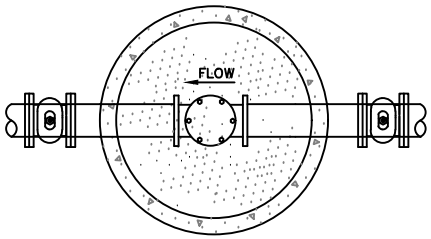

CHECK VALVE IN PRECAST UTILITY VAULT

NOT TO SCALE

WATER PANEL 2B

BERKELEY COUNTY WATER AND SANITATION

POTABLE WATER & SANITARY SEWER STANDARDS

REVISED 04/25/2023