


NOTE:

1. MEGALUG GLANDS SHALL BE USED ON ALL MECHANICAL JOINTS.
2. SEE APPENDIX F29 FOR BCWS APPROVED HYDRANTS
3. PAINTED RED TO OPEN LEFT.
4. USE BOXLOK OR VALVE BOX ADAPTOR II FOR CENTERING BOXES OVER VALVES.
5. POLY WRAP ALL DIP AND FITTINGS

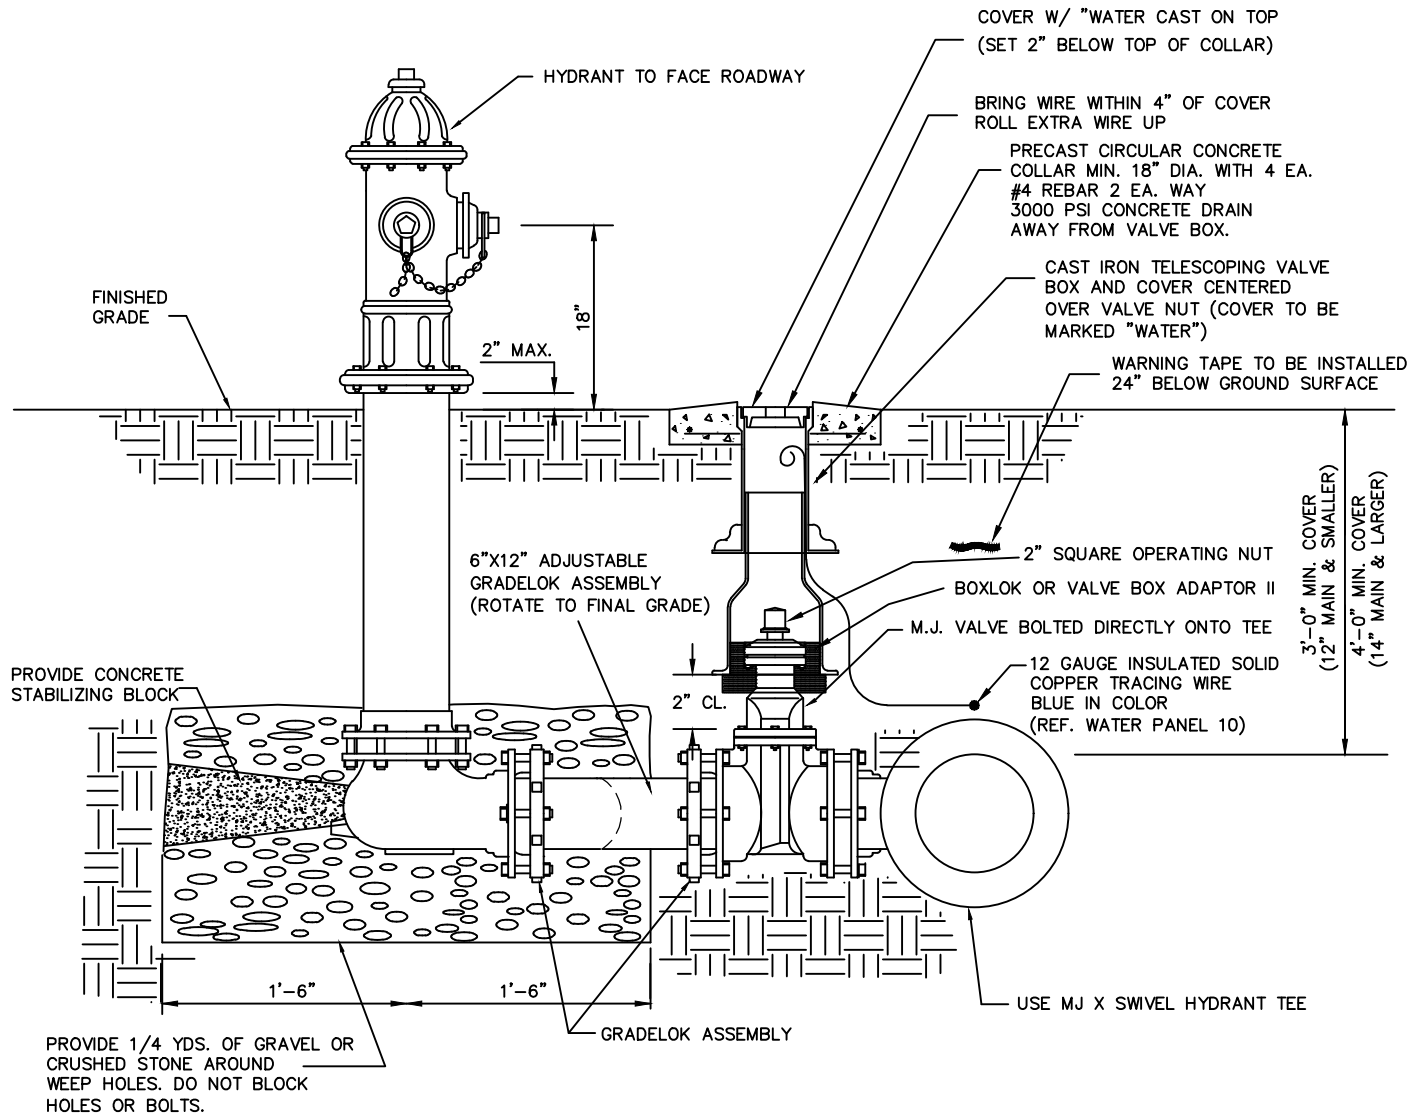

TYPICAL DETAIL

FIRE HYDRANT WITH VALVE AND BOX

NOT TO SCALE

WATER PANEL 4A

**BERKELEY COUNTY WATER AND SANITATION
POTABLE WATER & SANITARY SEWER STANDARDS**

REVISED 04/25/2023