


**NOTES:**

1. POST HYDRANT TO BE USED ON MAINS SMALLER THAN 6" (UNLESS SPECIFIED BY BCWS).
2. USE BOXLOK OR VALVE BOX ADAPTOR II FOR CENTERING BOXES OVER VALVES.
3. POLY WRAP ALL DIP AND FITTINGS

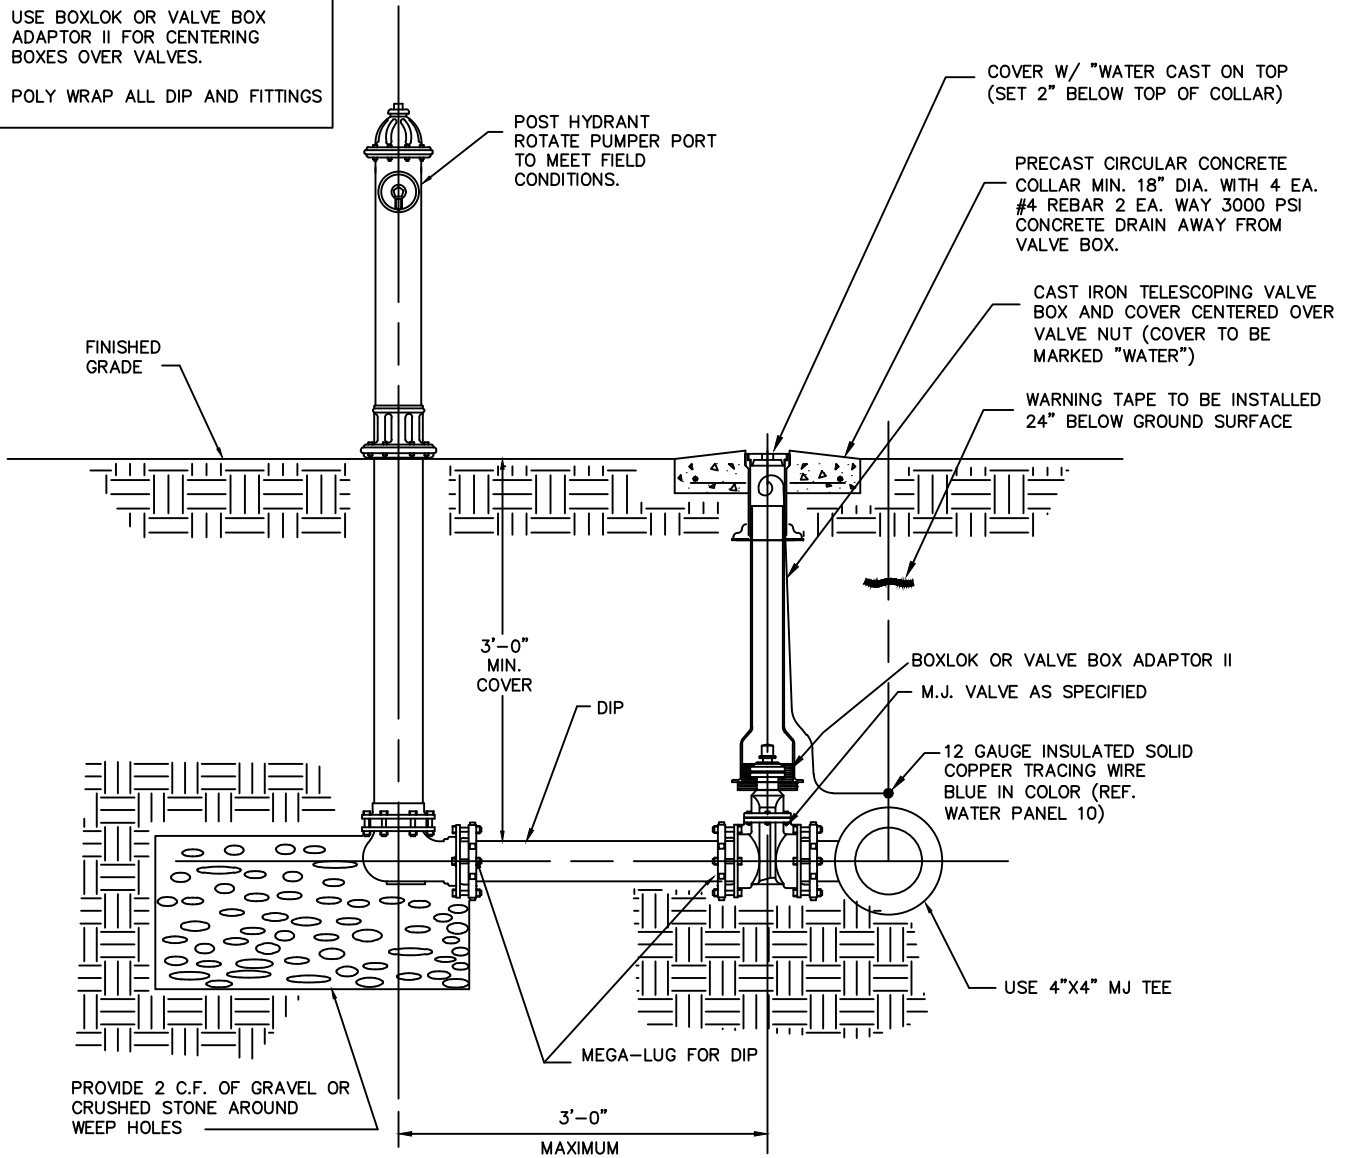

*TYPICAL DETAIL*

*POST HYDRANT WITH VALVE AND BOX*

NOT TO SCALE

**WATER PANEL 4C**

**BERKELEY COUNTY WATER AND SANITATION  
POTABLE WATER & SANITARY SEWER STANDARDS**

REVISED 04/25/2023